

# Recombinant BMP Binding Endothelial Regulator (BMPER) Instruction Manual

**SIPJ442Hu01**

**Homo sapiens (Human)**

<b>Source</b>	Prokaryotic expression
<b>Host</b>	E.coli
<b>Endotoxin Level</b>	<1.0EU per 1µg (determined by the LAL method)
<b>Subcellular Location</b>	Secreted
<b>Predicted Molecular Mass</b>	31.0kDa
<b>Accurate Molecular Mass</b>	31kDa(Analysis of differences refer to the manual)
<b>Residues &amp; Tags</b>	Ser40~Cys289 with N-terminal His Tag
<b>Buffer Formulation</b>	PBS, pH7.4, containing 0.01% SKL, 5% Trehalose.
<b>Traits</b>	Freeze-dried powder
<b>Purity</b>	> 90%
<b>Isoelectric Point</b>	6.0
<b>Applications</b>	Positive Control; Immunogen; SDS-PAGE; WB.

## SEQUENCE

S SFLTGSVAKC  
ENEGEVLQIP FITDNPCIMC VCLNKEVTCK REKCPVLSRD CALAIKQRGA  
CCEQCKGCTY EGNTYNSSFK WQSPAEPVCL RQCQEGVVTE SGVRCVVHCK  
NPLEHLGMCC PTCPGCVFEG VQYQEGEEFQ PEGSKCTKCS CTGGRTQCVR  
EVCPIILSCPQ HLSHIPPGQC CPKCLGQRKV FDLPGSCLF RSDVYDNGSS  
FLYDNCTACT CRDSTVVCKR KCSHPGGCDQ GQEGCCEEC

## USAGE

Reconstitute in ddH<sub>2</sub>O to a concentration of 0.1-0.5 mg/mL. Do not vortex.


## STORAGE

Avoid repeated freeze/thaw cycles. Store at 2-8°C for one month. Aliquot and store at -80°C for 12 months.

## **STABILITY**

The thermal stability is described by the loss rate. The loss rate was determined by accelerated thermal degradation test, that is, incubate the protein at 37°C for 48h, and no obvious degradation and precipitation were observed. The loss rate is less than 5% within the expiration date under appropriate storage condition.

## **Image**

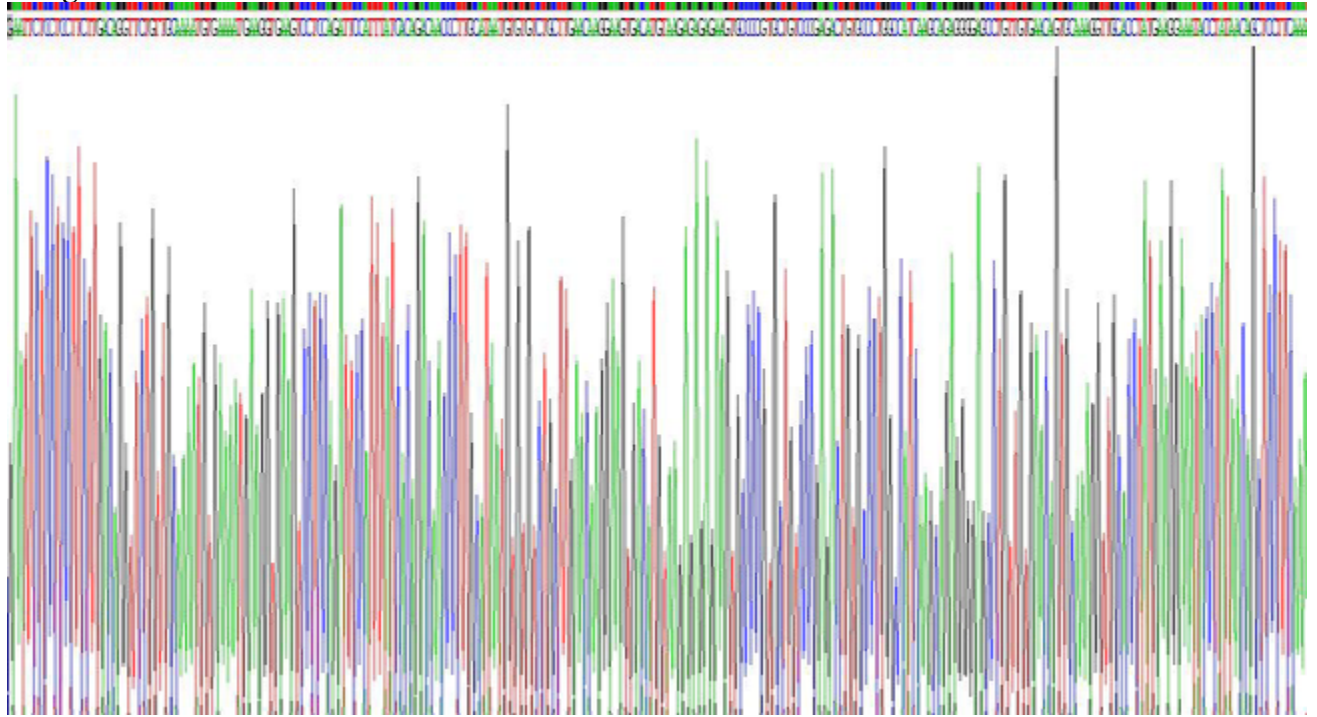

SDS-PAGE Image

## **[IMPORTANT NOTE]**

The kit is designed for research use only, we will not be responsible for any issue if the kit was used in clinical diagnostic or any other procedures.